
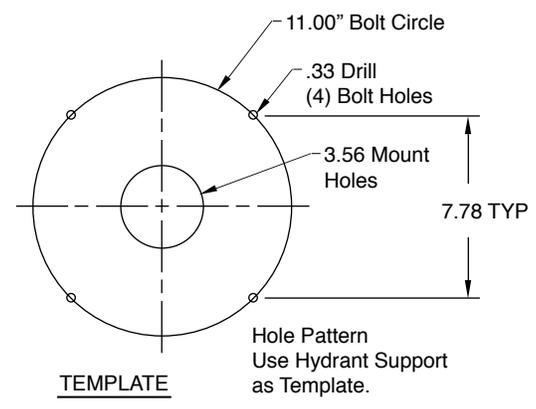
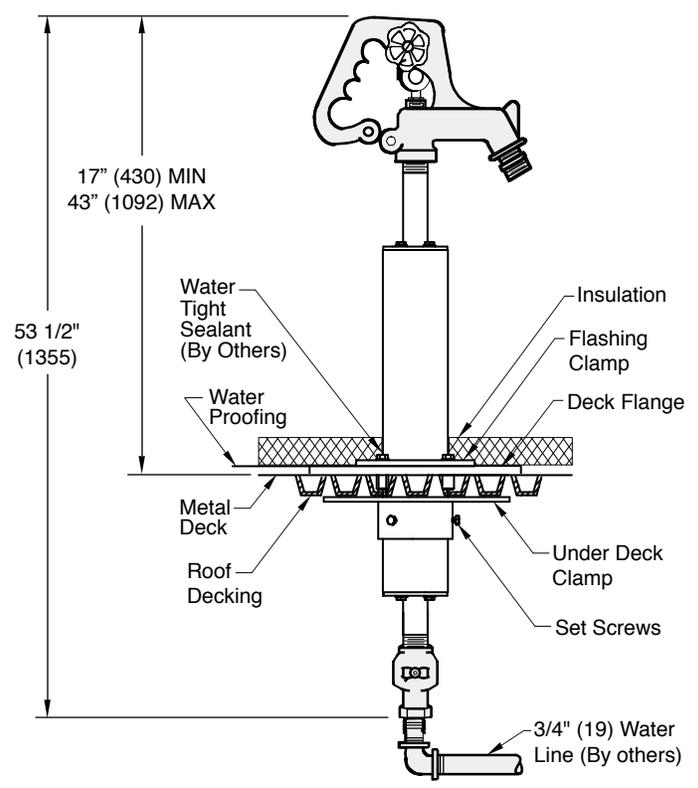


DRAWING NUMBER **S5906**
 SIZE **A**
 SCALE: **NONE**
 DATE: **3/4/09**
 APPROVED BY: **AM**
 CHECKED BY: **AM**
 DRAWN BY: **RN**

NON-FREEZE ROOF HYDRANT

FUNCTION: Provides water availability for window washing, cleaning of condenser coils, cooling towers and other types of roof equipment. Valve body of hydrant is drilled and tapped with 1/8" drain hole which must be piped to a drain location.

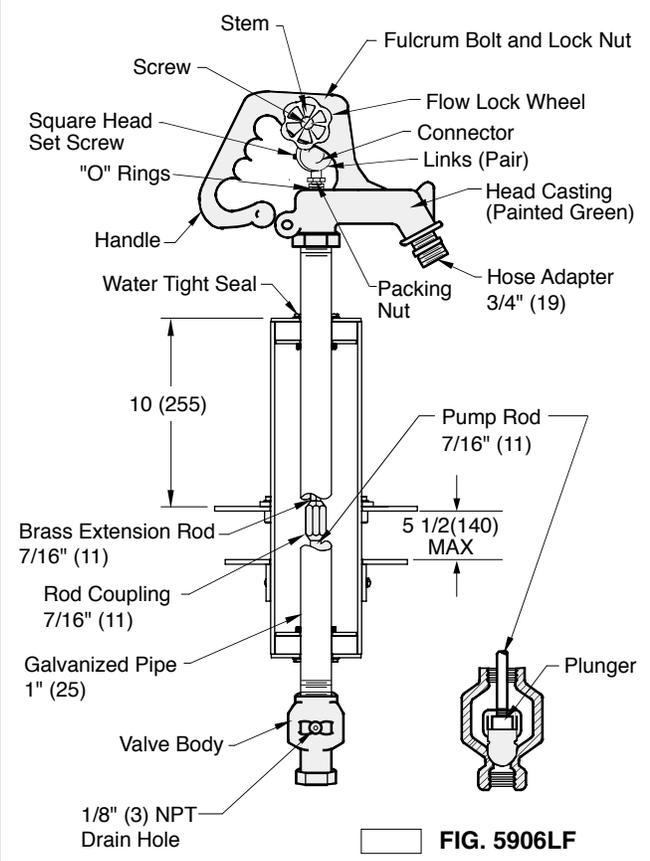

- NOTE:**
1. Drain Hole must be piped and discharged to an acceptable discharge point. Failure to do so will result in potential water damage which Smith is not responsible.
 2. Hose must be removed to allow proper draining of the casing. Smith is not responsible for any casings that burst or related incidents if the hose is not removed.
 3. The AB1953, California Lead Law, and NSF/ANSI Standard 61-2008 - Drinking Water System Components are not applicable to Jay R. Smith hydrants as they do not convey/dispense water for human consumption through drinking or cooking.
 4. Dimensions shown in parentheses are in millimeters.
 5. **FOR IRRIGATION PURPOSES ONLY.**

REGULARLY FURNISHED:
 Non-Freeze Roof Hydrant with Galvanized Casing and Adjustable Flow Wheel Lock Handle with Deck Flange and Under Deck Clamp.

VARIATIONS:
 Vacuum Breaker -H (Note 2)

Certified by Truesdail Laboratories. Meets all Federal and state Safe Drinking Water Acts and requirements.
 NSF/ANSI 372

5906

DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE

REV.	DATE	DESCRIPTION	BY	CKD. BY	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER
J	1-9-15	Revised Callout	TBW	CL			5906 (5900LF SERIES)
H	8-22-14	Revised Note	TBW	CL			
G	1-21-14	Added Truesdail Note	TBW	JM			
F	2-5-13	Revised Notes	TBW	CL			